

Read these instructions before installation and retain for future reference. This equipment should be installed by a competent electrician




Important Information

We recommend that luminaires are installed by a qualified electrician ensuring the installation complies with current IEE wiring regulations BS7671:2018 & local building control.

- All tests should be carried out in accordance to EN 50172:2004.
- BELL will not accept responsibility for any claims arising from poor installation.

Important User Advice

- The ambient room temperature should not exceed 60°C.
- Ensure that there is adequate free air ventilation around the fitting.
- Always switch off mains supply before installing.

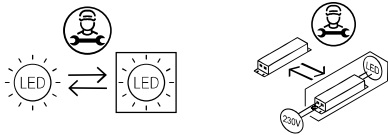


This product may contain substances that can be hazardous to the environment if not disposed of properly. Electrical and electronic equipment should never be disposed of with general household waste but must be separated for its correct treatment and recovery. Where possible recycle your packaging.




Power&CCT Selectable (optional)

1. 

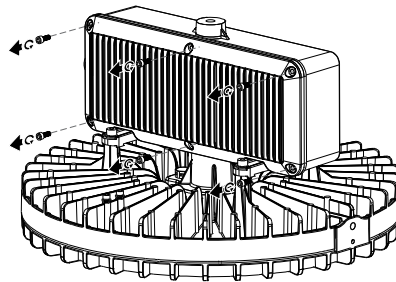

2. 

Warning: please power off the luminaire before adjusting DIP switch.

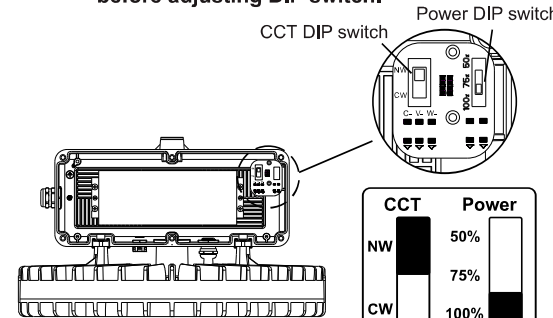


CW: 5000K NW: 4000K
100%: 200W 75%: 150W 50%: 100W

Suspension Mounting

1. 




Make sure the screw is tightened

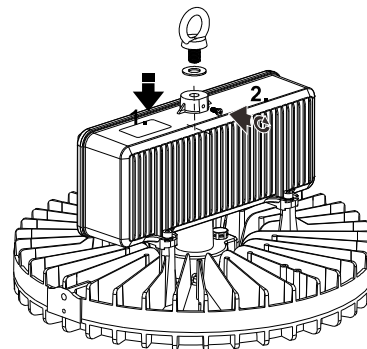

2. 

Recommended Hook Size:
Ø6x60mm/
Ø8x80mm

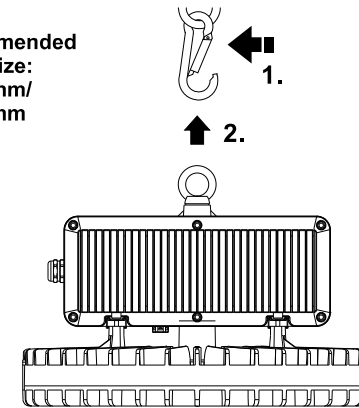

Warning! Do not wire dim cord to high voltage, or dim function will fail.

DIM cords

Note: color for dim cords subject to the cable label on luminaire

AC cords

L	brown	black
N	blue	white
⊕	yellow/green	green