



TS 7306 Floor Spring

PS190 Double Action Kits


For Double action fire doors use Intumescent kit IP.190 = Blue

714.1


www.rutlanduk.co.uk

PS 190 Double Action Door Kit


1 Fit Cement Box (Plan View)

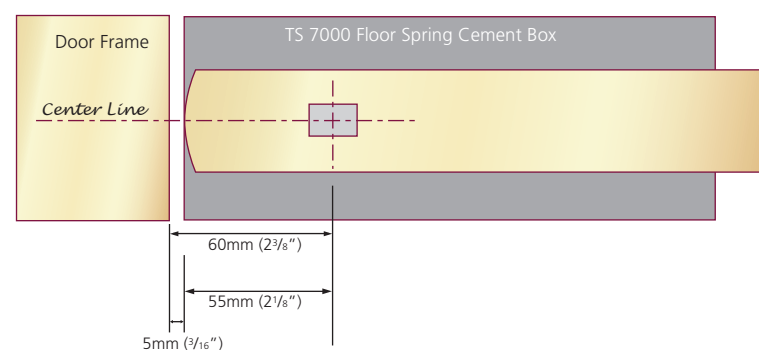




2 Bottom Door Fitting (Side View)

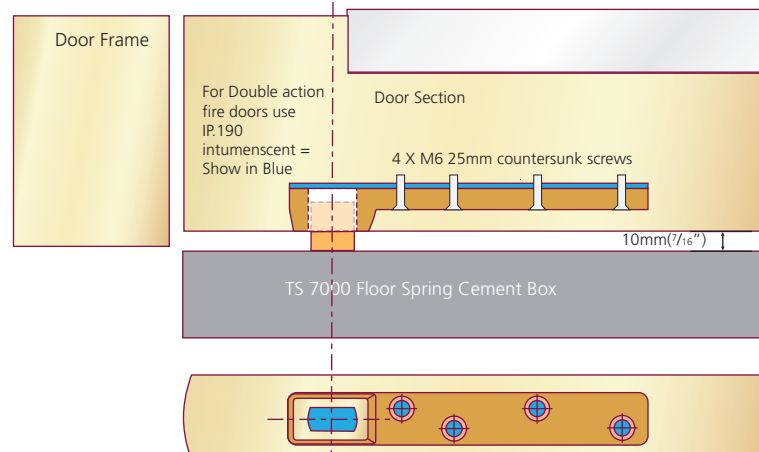


Bottom Door Fitting (Bottom View)




3 Top Door Fitting (Side View)

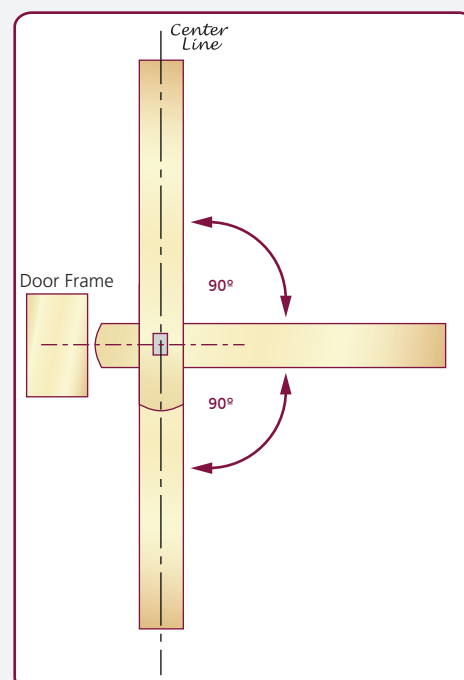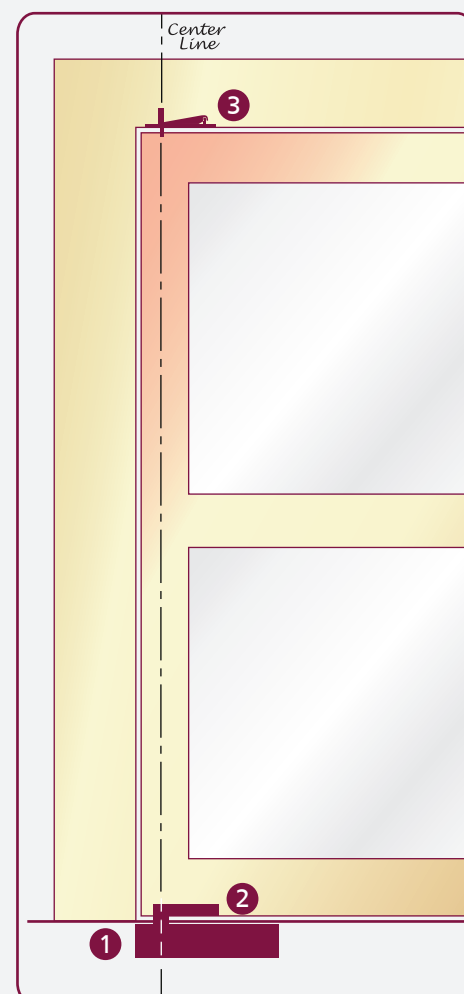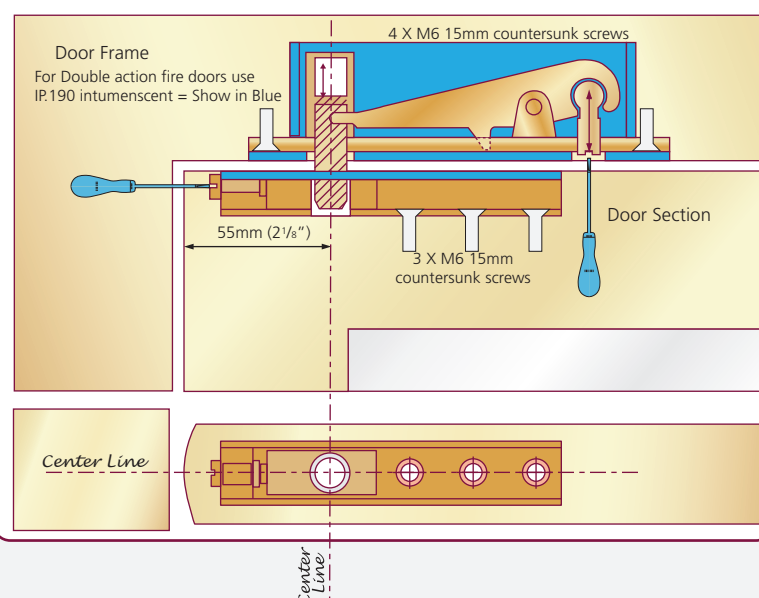

Minor Position Adjustment

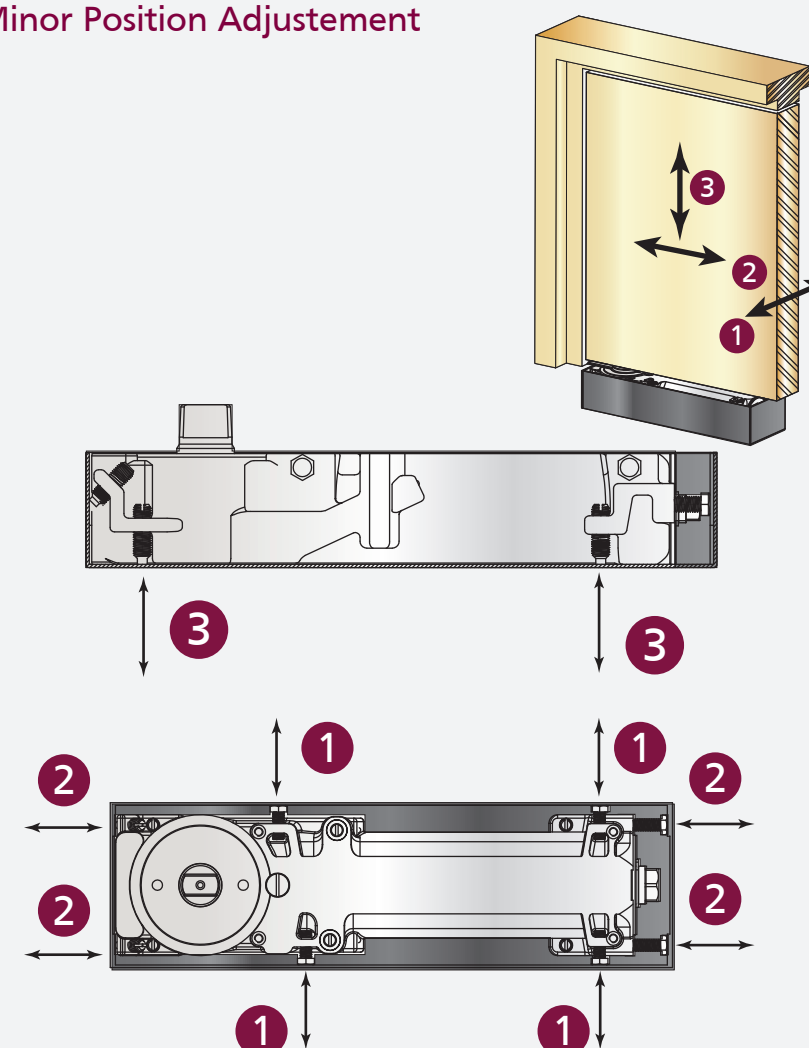

Closing and Latching Adjustment

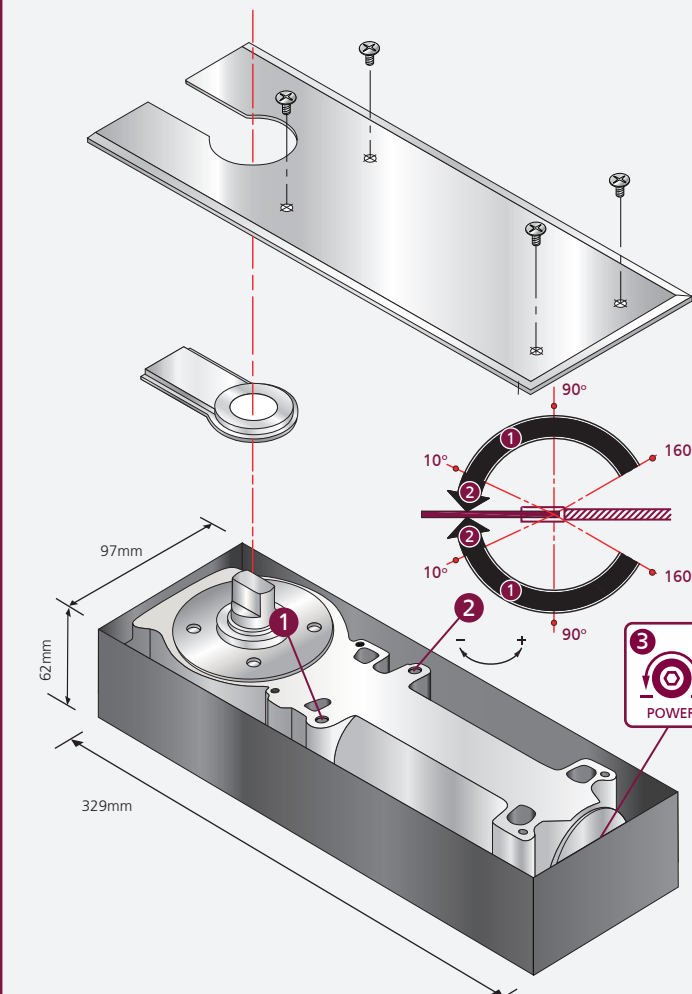

3-6 Power Size

Model/Unit	EN Size	Max. weight kg	Max. door width	Max. opening angle
TS 7306	3	105	950mm	150°
TS 7306	6	300	1400mm	150°

IMPORTANT NOTES:
THE PINION BOLT MUST BE TIGHTENED TO 12Nm.

DOOR CLOSERS ARE NOT INTENDED TO OVERCOME EXCESSIVE AIR PRESSURES OR POORLY DESIGNED SMOKE SEALING

A MECHANICAL DOOR CLOSER IS NOT DESIGNED TO OVERCOME POOR FITTING, EXCESSIVE AIR PRESSURES OR BINDING SMOKE AND WEATHER SEALS. EXCESSIVE AIR PRESSURES CAN BE CREATED BY THROUGH DRAFT, BY AIR CONDITIONING, BY SMALL ROOMS WITHOUT VENTILATION, OR WHERE NO AIR TRANSFER GRILLS ARE FITTED. MECHANICAL DOOR CLOSERS ARE DESIGNED TO CLOSE THE STATED AND TESTED SPECIFICATION OF DOOR WEIGHT AND DOORSETS/DOOR ASSEMBLIES WHEN DOORS ARE FITTED WITH CORRECT GAPS AND NOT BINDING ON SEALS. IF YOU ENCOUNTER PROBLEMS WITH DOORS NOT CLOSING PLEASE WATCH OUR "6 WAYS TO TROUBLESHOOT A DOOR CLOSER" VIDEO ONLINE. WHERE DOORS ARE NOT CLOSING DUE TO AIR PRESSURES THEN PROFESSIONAL ADVICE FROM AN AUTHORISED INSTALLER IS RECOMMENDED TO FIT TESTED AND THIRD PARTY CERTIFIED AIR TRANSFER GRILLS AND/OR AUTOMATIC DOOR OPERATORS. NOTE: BC VALVES ARE DESIGNED TO ASSIST BACK-CHECK AND DO NOT REPLACE THE REQUIREMENT FOR CORRECTLY FITTED DOORSTOPS OR SAFETY BARRIERS.

FURTHER WARRANTY INFORMATION: <https://www.rutlanduk.co.uk/rutland-warranty>